


TA2020-020

APPLICATION / TEST CIRCUIT

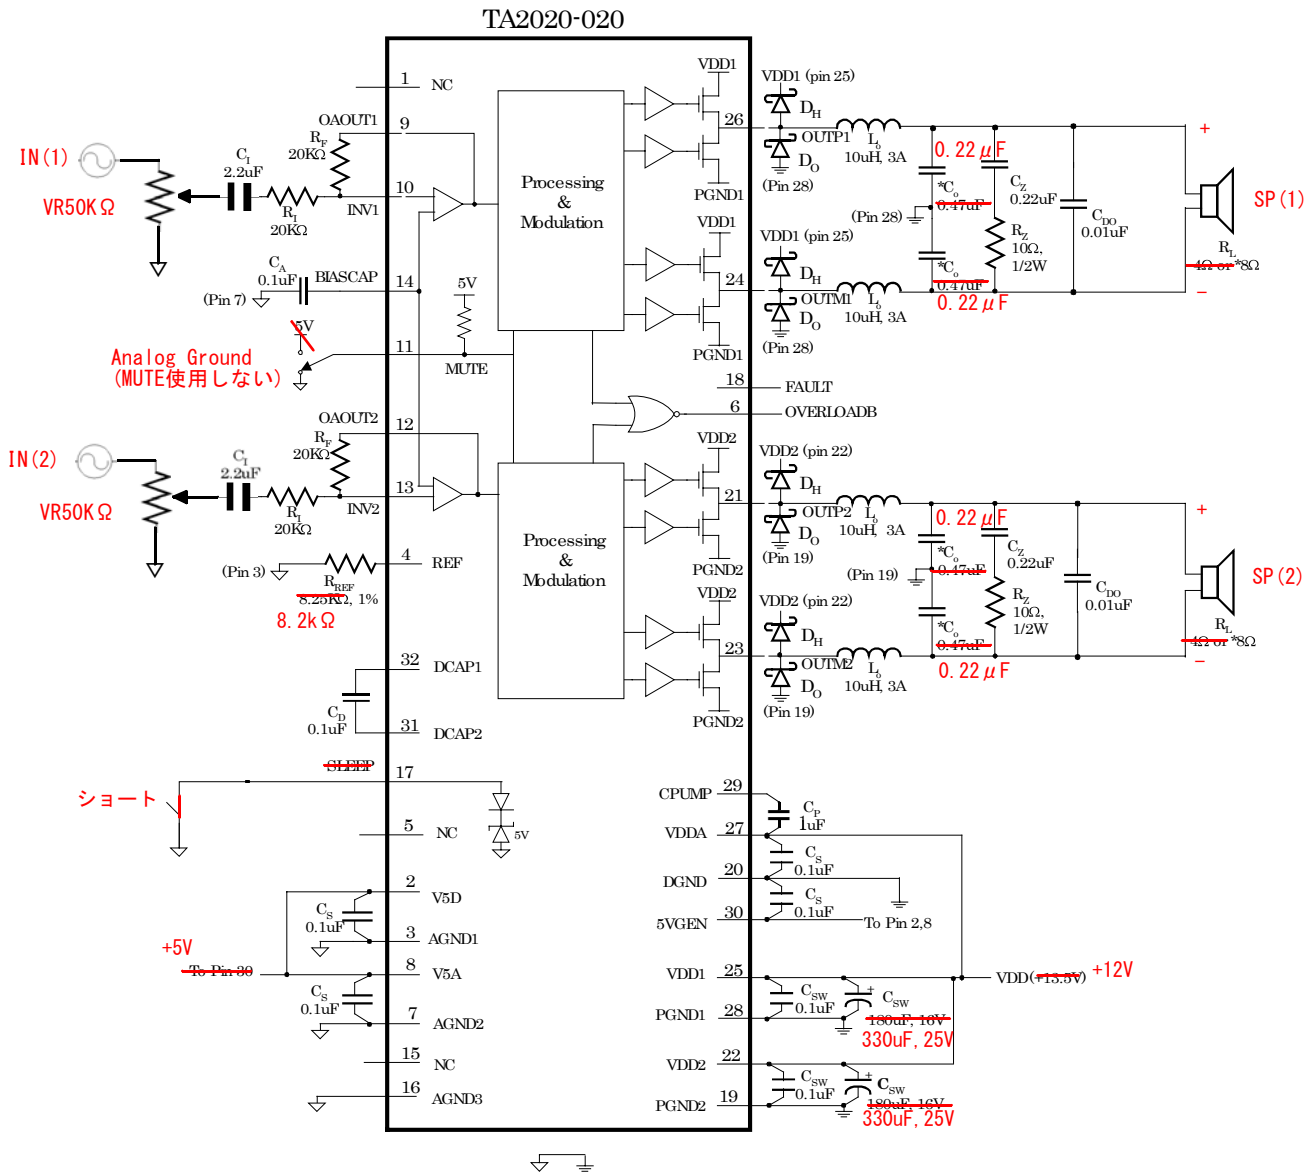

Note: Analog and Digital/Power Grounds must be connected locally at the TA2020-020

⏏ Analog Ground

⏏ Digital/Power Ground

Diodes (D_O and D_H) are Motorola MBRS130T3 (the D_H diodes are required for V_{DD}>13.5V)

* Use C_O = 0.22μF and C_Z = 0.22μF for 8 Ohm loads

■電源■ (12V, 5V)

